


# MB LMT 525

## Monoblock High Ratio Regulation THERMAL STEEL FLAME TUBE

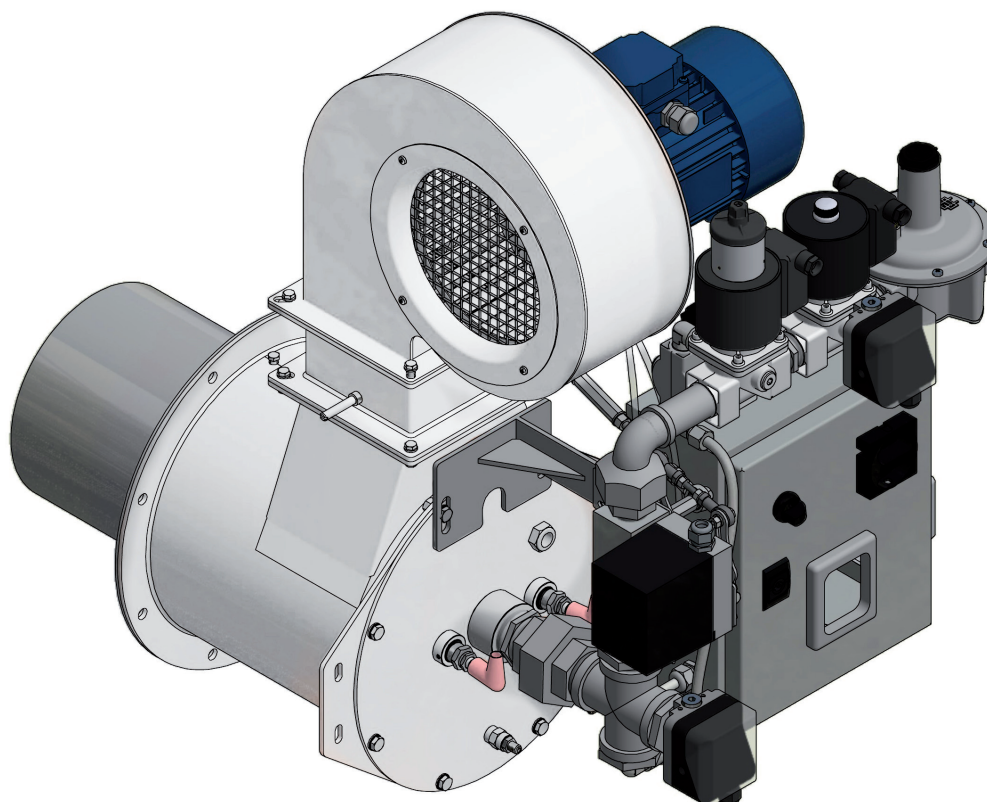

### MB LMT 525

Maximum output [kW]		525
Minimum output (air/gas regulation) [kW]		18
Minimum output (fixed air) [kW]		25
Fuel pressure at maximum capacity (upstream of the stabilizer) [mbar]	Natural gas (8250 kcal/Nm <sup>3</sup> )	80
	LPG (22500 kcal/Nm <sup>3</sup> )	40
Operating conditions in the combustion chamber at maximum capacity [mbar]	Maximum back pressure	1
	Minimum depression	-8
Flame length at maximum capacity [mm] (measured at the end of the burner body)	Natural gas (8250 kcal/Nm <sup>3</sup> )	1200
	LPG (22500 kcal/Nm <sup>3</sup> )	1350
Flame detection	Ionization flame detection electrode (UV cell on request)	
Fuel	Natural gas (LPG and other gaseous fuel on request)	

All information is based on laboratory tests in a neutral pressure chamber. Different conditions and chamber sizes can affect the data.

All information is based on a standard combustor design. Modifications to the combustor will alter performance and pressures.

All data are based on gross calorific values.

All information is based on tests conducted on generally acceptable air and gas piping systems.


Data reported in this technical sheet are subject to change without notice.

Performance data and dimensions are guidelines only and are not binding.

ELCO reserves the right to modify the construction and / or configuration of its products at any time


## CHARACTERISTICS OF THE BURNER

Fuel 1: CH<sub>4</sub>  
 Fuel 1 diaphragm: Ø\*\*  
 Fuel 2: LPG  
 Fuel 2 diaphragm: Ø\*\*  
 Comburent: Air  
 Comburent diaphragm: Sp.18

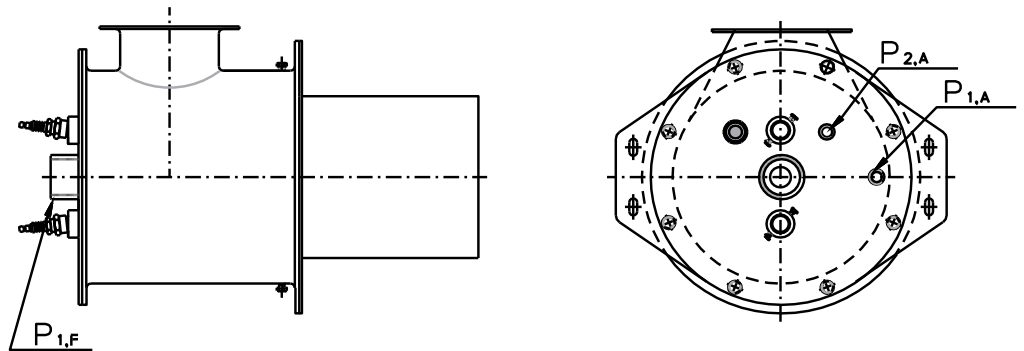


## OPERATING RANGE

### TYPICAL OPERATING RANGE

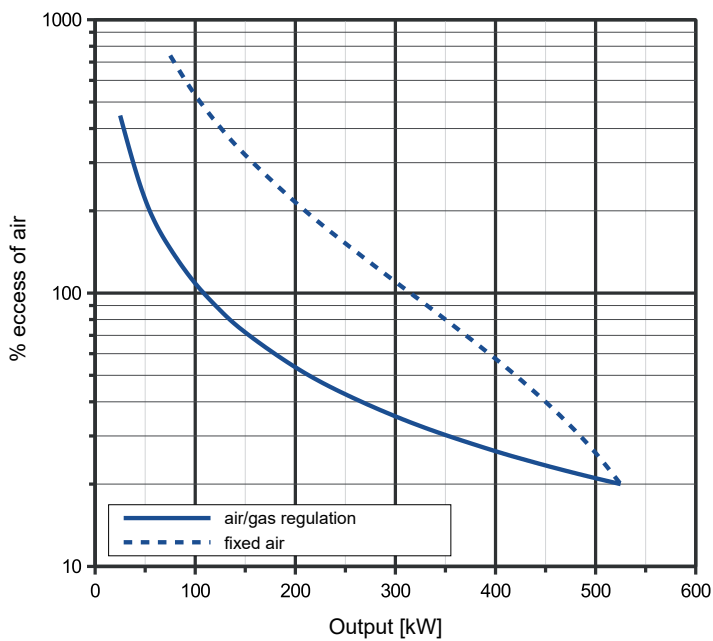

### WORKING FIELD

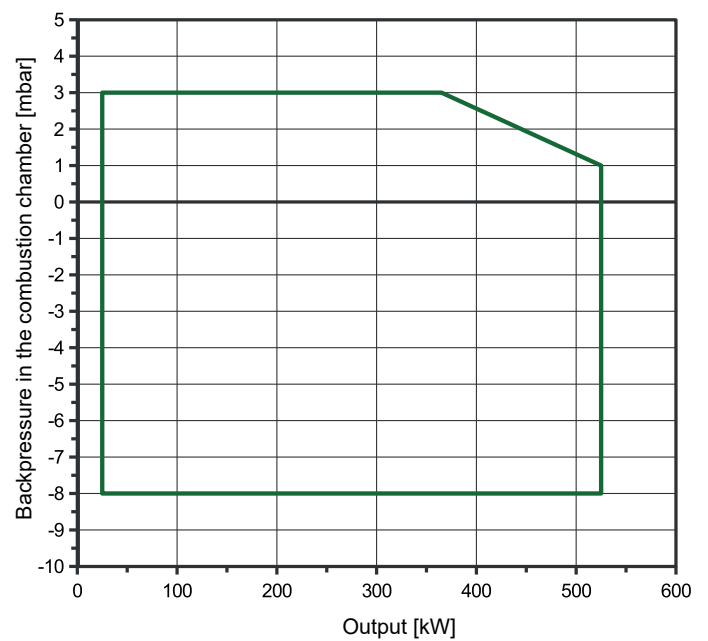

### LEGENDA

$Q_F$  Fuel flow  
 $Q_A$  Air flow


$P_{1,F}$  Fuel pressure  
 $P_{1,A}$  Air pressure upstream the diaphragm

$P_{2,A}$  Air pressure downstream the diaphragm  
 $\Delta P_A$  Differential pressure between ports 1 and 2


### FLOW RATE CURVES

$Q_F$ [Nm <sup>3</sup> /h]	FUEL	
	$P_{1,F}$ [mbar]	
	Natural gas	LPG
4	0.03	0.48
6	0.07	1.08
8	0.13	1.92
10	0.20	3.00
12	0.29	4.31
14	0.40	5.87
16	0.52	7.67
18	0.66	9.71
20	0.82	11.99
22	0.99	
24	1.18	
26	1.38	
28	1.61	
30	1.84	
35	2.51	
40	3.28	
42.5	3.70	
45	4.15	
47.5	4.62	
50	5.12	
52.5	5.65	
55	6.20	
57.5	6.77	
60	7.37	

$Q_A$ [Nm <sup>3</sup> /h]	AIR	
	$P_{1,A}$	$\Delta P_A$
	[mbar]	[mbar]
50	0.04	0.03
100	0.15	0.11
150	0.33	0.25
175	0.44	0.34
200	0.58	0.44
225	0.74	0.56
250	0.91	0.69
275	1.10	0.83
300	1.31	0.99
325	1.53	1.16
350	1.78	1.35
375	2.04	1.54
400	2.32	1.76
450	2.94	2.22
500	3.63	2.75
550	4.39	3.32
600	5.23	3.95
650	6.14	4.64
700	7.12	5.38
750	8.17	6.18
800	9.29	7.03
850	10.49	7.94
900	11.76	8.90
1000	14.52	10.98

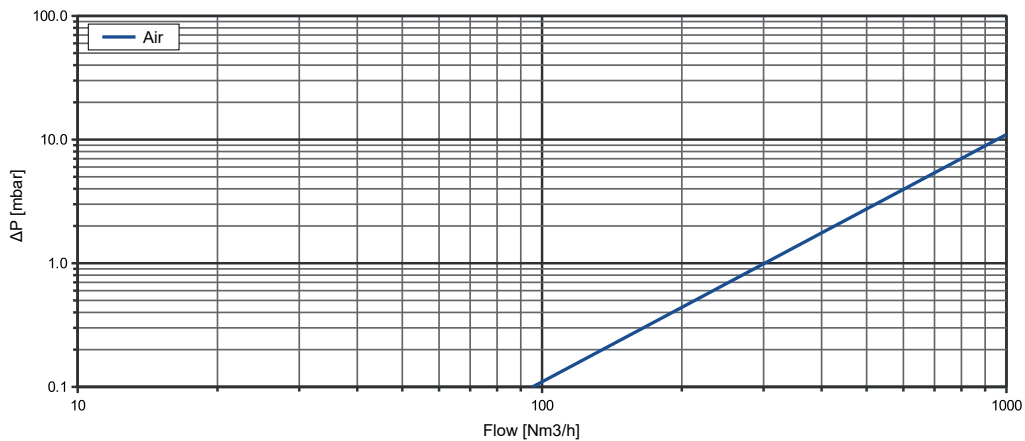

### FUEL SUPPLY PRESSURE

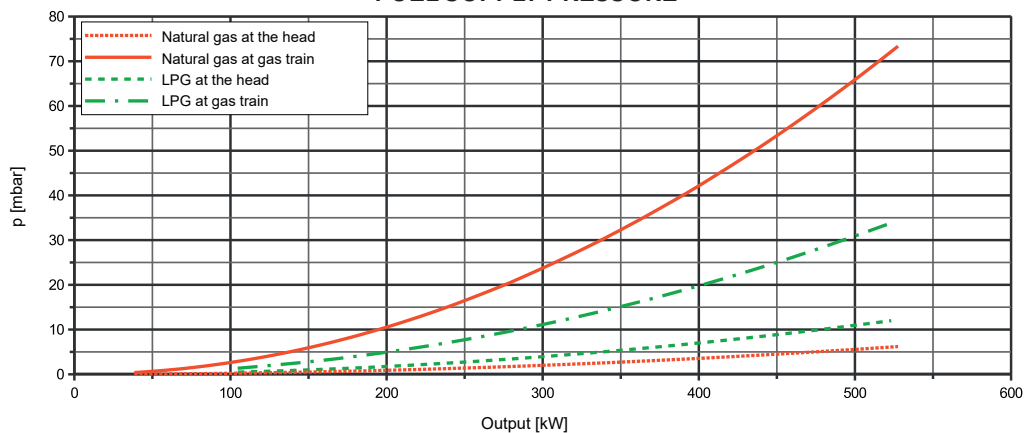

DIMENSIONS [mm]

